

F.P. 1657-A.


ELEVATIONS AND WATER PRESSURES AT VARIOUS PLACES

TRIMOUNTAIN

LEFAX FILING INDEX

Adams Township, MI

PLACE	ELEV.	PRESSURE	
		TANK FULL	TANK EMPTY
B.M. # 61 M.G.S.	70304	# 50	# 38
FINN CHURCH	720	43	31
TANK TOP	819	0	
" BOTTOM	789	13	0
#3 DAM core wall	615	121	101
#2 " " "	1		
ENG. HSE. FLOOR #2	62218	85	72
" " " #3	61947	87	74
" " " #4			
HOSPITAL	710	47	35
OFFICE FLOOR	68518	58	46
SHAFT COLLAR #1	593	98	85
" " #2	64463	75	62
" " #3	64723	74	61
" " #4	65314	72	59
SHOPS	610	91	79
1/4 28	4234	172	160
29			
PUMP STATION	369	196	184
BALTIC TANK TOP	715	0	-
" " BOT.	685	13	0

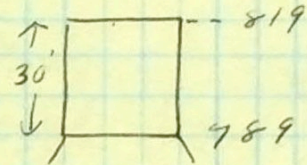

TRI. TANK.

Pressure = Dif. in Elev. X .434


F.P. 1657 H
 ELEVATIONS AND
 WATER PRESSURES

PAINESDALE

LEFAX FILING INDEX

Adams Township, MI

PLACE	ELEV.	PRESSURE	
		TANK FULL	TANK EMPTY
B.M. #59 MGS	737.5	69	50
DEPOT	602	128	109
DISPENSARY			
ENG. HSE. FLOOR #1	571.4	141	122
" " " #2			
" " " #3	591.4	133	114
" " " #4	589.5	134	115
" " " "F"	591.5	133	114
#2 ALGOMAH ST	697.9	87	68
#6 " "	711.9	80	61
G.M.'S. HOUSE	690	90	71
LIBRARY (7 30/31)	680.6	94	75
PUMP STATION	480	181	162
M. SHOP FLOOR	602.9	127	108
STORE	612	124	105
SHAFT COLLAR, #1			
" " #2			
" " #3			
" " #4	610		
" " GLOBE	648.4	—	—
STA. 1023 (Δ)	608	125	106
TANK, TOP	890.8	0	
" BOTTOM	852.8	19	0
Boiler HSE. Floor #3	556.7	147	128
" " " "F"	580.3	137	118
"F" DAM CORE WALL	591.4	133	114

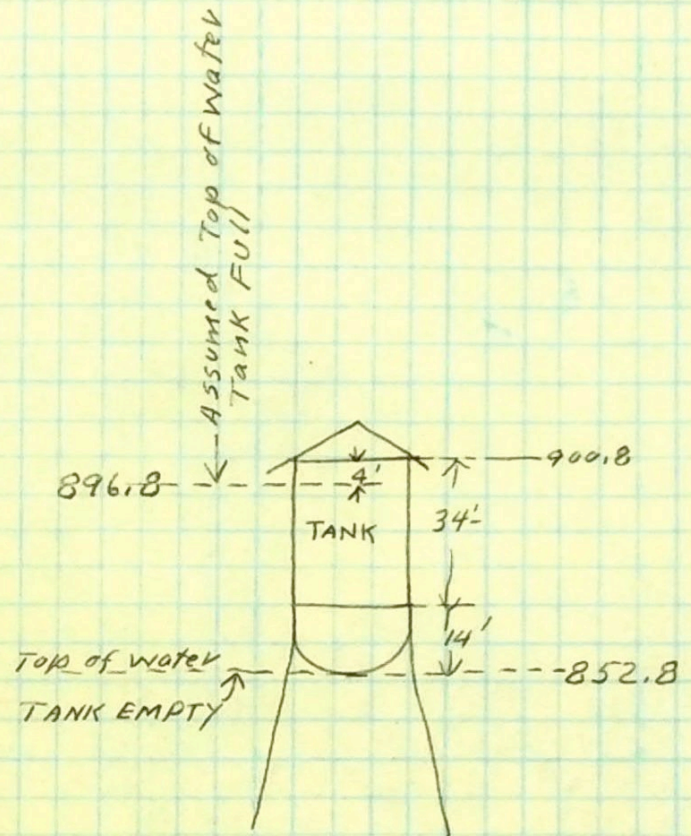

Water pressure =
 Dif. in Elev. x .434